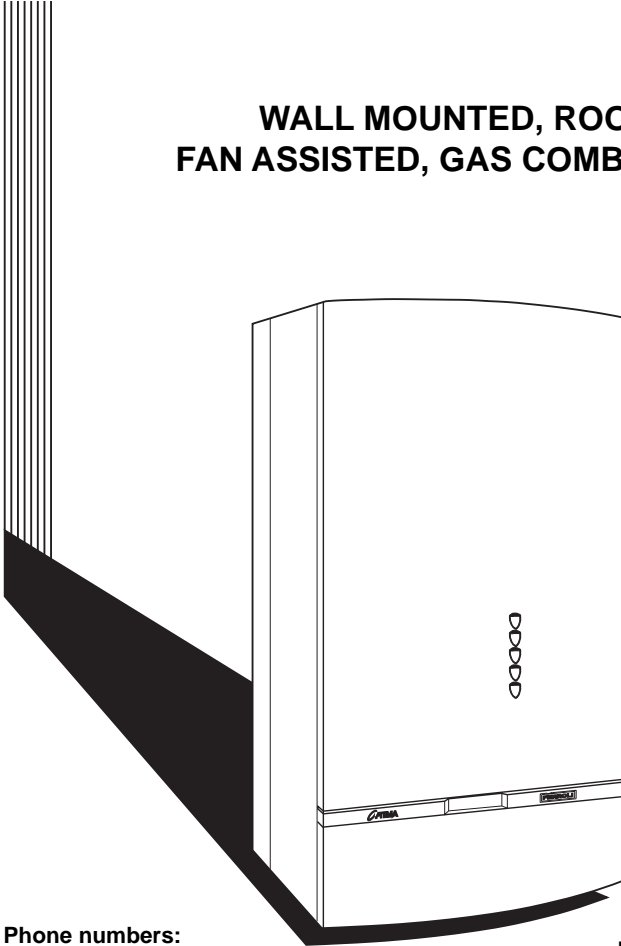


OPTIMA 1001

04/98

**WALL MOUNTED, ROOM SEALED,
FAN ASSISTED, GAS COMBINATION BOILER**



USERS INSTRUCTIONS

Read these Instructions thoroughly
before using the appliance

Appr. Nr. B94.01A CE 0063AQ2150

Phone numbers:

Installer _____

Service Engineer _____

Serial No. _____

FERROLI HELPLINE

**FOR SERVICE INFORMATION OR
HELP TELEPHONE: 0121 3523500
ALWAYS QUOTE YOUR SERIAL NUMBER
FOR IMMEDIATE ASSISTANCE**

G.C. NO: 47-267-19

ALL SPECIFICATIONS SUBJECT TO CHANGE

Stockton Close, Minworth Industrial Park, Minworth, Sutton Coldfield, West Midlands B76 8DH
Tel.: 0121/3523500 - Fax 0121/3523510

Conditions of Installation

GAS SUPPLY

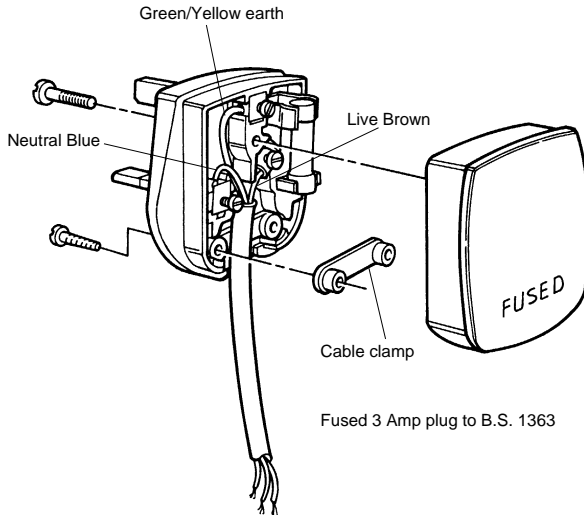
It is the law that all gas appliances are installed and serviced by a competent person in accordance with the Gas Safety Regulations (Installation & Use) 1994, and the manufacturers instructions. Failure to observe these requirement may lead to prosecution.

ELECTRICAL SUPPLY 230 V ~ 50 Hz FUSED 3A.

The electrical wiring must be carried out by a qualified electrician.

The colours of the wires in the mains lead of this appliance may not correspond with the coloured markings identifying the terminal in the plug. Therefore proceed as follow:

The wire coloured green and yellow must be connected to the terminal in the plug marked with either the letter E or by the earth symbol or coloured green or green and yellow. The wire coloured blue must be connected to the terminal marked either with the letter N or coloured black. The wire coloured brown must be connected to the terminal marked either with the letter L or coloured red.



MINIMUM CLEARANCE

The minimum clearance around the appliance should be as follows:

Sides 5 mm

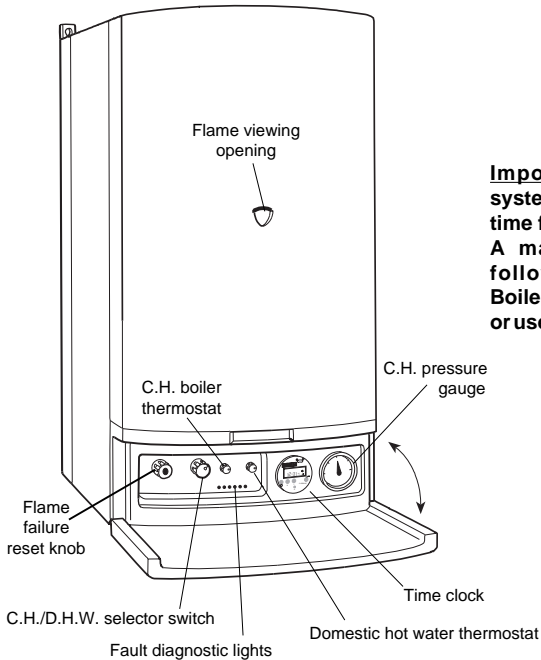
Front 600 mm

Below 200 mm

Above 100 mm

Note: If a side outlet flue is to be used, a clearance of 75 mm will be needed on the flue outlet side of the boiler.

Boiler Lighting Instructions



Important: the Control system has a built in waiting time for Central Heating. A max. 3 minutes delay following shut down of Boilerstat, Clock, Roomstat or use of Hot Water is normal.

1. Open control panel cover by pulling at either side.
2. Ensure that the C.H./D.H.W. selector switch is set for: "**Heating Continuous and Hot Water**".
3. Ensure that the electricity supply is turned on.
4. Ensure that the heating system is filled with water and has not been drained down. (Pressure gauge should read 1.0 bar minimum).
5. Adjust the room thermostat (if fitted) to a high setting.
6. Adjust the boiler thermostat to its maximum setting. After a waiting time of max 3 minutes, fan in boiler will commence to run after which boiler will fire.
7. Set the time clock, room thermostat (if fitted) and the boiler thermostat to their desired settings.

Note 1 - The main burner will light whenever a hot tap is turned on.

Note 2 - If the flame failure lock out light (within knob) is illuminated wait 10 seconds and press the flame failure reset knob, the boiler should then light

To Shut Down The Boiler For Short Periods

1. Set the C.H./D.H.W. selector switch to **hot water**. (In this position the pilot burner will remain alight, and the main burner will only operate when domestic hot water is required).

To Shut Down The Boiler For Long Periods

1. Turn off the electricity supply.

Boiler Controls

1.0 CENTRAL HEATING SELECTOR SWITCH

The central heating selector switch has three positions, these are:

- a) **Heating Timed & Hot Water**
For domestic hot water supply and central heating controlled by the time clock.
- b) **Hot Water**
For domestic hot water supply only.
- c) **Heating Continuous & Hot Water**
For the domestic hot water supply and continuous central heating.

Note - When central heating is not required the selector switch must be turned to the position marked "**Hot Water**".

2.0 TIME CLOCK

A time clock is fitted to the boiler to control the Central Heating, this will come into operation when the Selector Switch is turned to the position marked "**Heating timed and Hot Water**".

3.0 BOILER THERMOSTAT TEMPERATURE SETTING

The boiler water temperature can be set by the boiler thermostat knob, which is variable from minimum to maximum. This control knob does not affect the temperature of the domestic Hot Water.

4.0 DOMESTIC HOT WATER THERMOSTAT TEMPERATURE SETTING

The domestic hot water temperature can be set by the D.H.W. thermostat knob, which is variable from minimum to maximum. This control knob does not affect the temperature of the central heating.

5.0 DOMESTIC HOT WATER

When any domestic hot water tap is turned on the boiler will provide hot water. With the domestic hot water thermostat knob to maximum, minimum flow rate the water will be approximately 70°C and a maximum flow rate the water will be approximately 40°C (normal running is approximately 60°C).

6.0 SERVICING

The boiler must be checked and serviced by your installer or other competent person at least once a year.

General Notes

1.0 SPACE OF GAS

Should a gas leak be suspected, turn off the gas supply at the meter then contact the Local Region of British Gas P.L.C. without delay.

2.0 SYSTEM WATER PRESSURE

If the water pressure in the central heating system, as indicated by the pressure gauge, falls below 1.0 bar, contact your installer, Service Engineer or other competent person to top it up.

3.0 VENTILATION

If the appliance is installed in a compartment or cupboard, do not obstruct any purpose provided ventilation openings.
Do not use the compartment or cupboard for storage purposes.

4.0 FROST PROTECTION

Note - The boiler has its own built-in frost protection which automatically fire the boiler in low temperature situations irrespective of the selector switch setting. Electricity supply must be left on.

For frost protection of the system (radiator, etc.), a frost thermostat can be fitted, or if the boiler is turned off for long periods contact your installer or other competent person to drain the system. The system must be re-filled by your installer or other competent person.

5.0 HIGH LIMIT CUT-OFF THERMOSTAT

The boiler is fitted with a safety overheat cut-off thermostat, should it operate the pilot burner will go out. Should this happen, wait at least 3 minutes before attempting to re-light the boiler. The boiler should be relight in accordance with the «Boiler Lighting Instructions». If the safety overhead cut-off thermostat continues to fail consult your installer, service engineer or other competent person.

6.0 If the pump sticks, it can usually be freed by removing the chrome center screw (a small amount of water will escape) and manually free the impeller using a screwdriver in the end of the shaft.

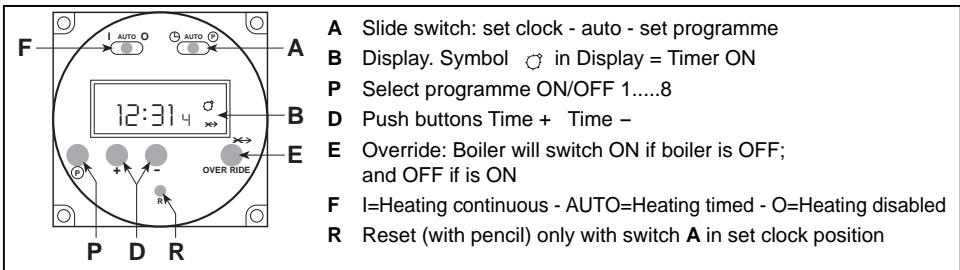
Simple Checks

If a fault is suspected or discovered, you should contact your installer, service engineer or other competent person. The following list however, is a series of simple checks that should be made before contacting your installer:

- Is the plug properly located in the socket and 3 amp fuse intact?
- Is the electricity supply switch on?
- Is gas supply on and is pilot alight?
- Is the room thermostat (if fitted) set high enough?
- Is the boiler thermostat set high enough?
- Is the time clock in the **ON** position? (i.e. calling for central heating)
- Are the radiator valves open?
- Is the central heating selector switch set correctly?
- Is the pressure on the pressure gauge indicating more than 1 bar?

Time Clock

A 24 hour time clock is fitted to the boiler to control the central heating, this will come into operation when the selector switch is turned to the position marked "heating timed and hot water".



To set time of day

- Slide switch (A) to left position
- Using button + and - adjust until the correct time is shown on display (B).


Pre Set Programmes. The timer is pre programmed with 3 ON and 3 OFF times.

6:30 - 8:30
12:00 - 12:00
16:30 : 23:30


If these are suitable no programming is required and the slide switch (A) can be moved to the Auto position and the central heating will be ON for these periods. (12:00 - 12:00 will not switch on the boiler)

To Set Own ON and OFF times. Symbol in Display = ON time


- Slide switch (A) to right position (P)

Display 


- Press button (P)

Display 


- Press button (P)

Display 


- Press button (P)

Display 

- Press button (P)


Display 

- Press button (P)


Display 

- The timer can be programmed with up to 8 ON and 8 OFF times by repeating the above procedure.


- 1.1 Use buttons + and - to set 1st ON time eg. 6:00

Display 


- 2.1 Use buttons + and - to set OFF time, eg. 9:00

Display 


- 3.1 Use button + and - to set 2nd ON time, eg. 12:30

Display 


- 4.1 Use button + and - to set 2nd OFF time eg. 14:00

Display 

- 5.1 Use button + and - to set 3rd ON time, eg. 16:00

Display 

- 6.1 Use button + and - to set 3rd OFF time eg. 23:30


Display 

8. On completion of programming slide switch (A) to Auto position, the time of day will be displayed and the central heating will switch ON and OFF according to the programme set.

Over ride

By pressing the over ride button (E) the timer programme is over ridden ie, if programme is in OFF time it will come ON and if in ON time will go OFF.

The timer will revert back to it set programme on reaching the next ON or OFF time.

When the programme is on over ride the sign  will be shown in the display window (B).

Reset Button

By the use of a pencil the reset button can be pushed (R). This will clear all programmes apart from those factory pre set.

Reset is only possible with switch (A) in set Clock position!

IMPORTANT:

If the pump sticks, it can usually be freed by removing the chrome center screw, (a small amount of water will escape) and manually free the impeller using a screwdriver in the end of the shaft.

Phone numbers:

Installer _____

Service Engineer _____

BECAUSE OF OUR CONSTANT ENDEAVOUR FOR IMPROVEMENT DETAILS MAY VARY SLIGHTLY FROM THOSE QUOTED IN THESE INSTRUCTIONS.

Cod. 3540247/1 - 04/98

ALL SPECIFICATIONS SUBJECT TO CHANGE

Stockton Close, Minworth Industrial Park, Minworth, Sutton Coldfield, West Midlands B76 8DH
Tel.: 0121/3523500 - Fax 0121/3523510
